


Maryland Energy Code Coach

Building Thermal Envelope Air Leakage

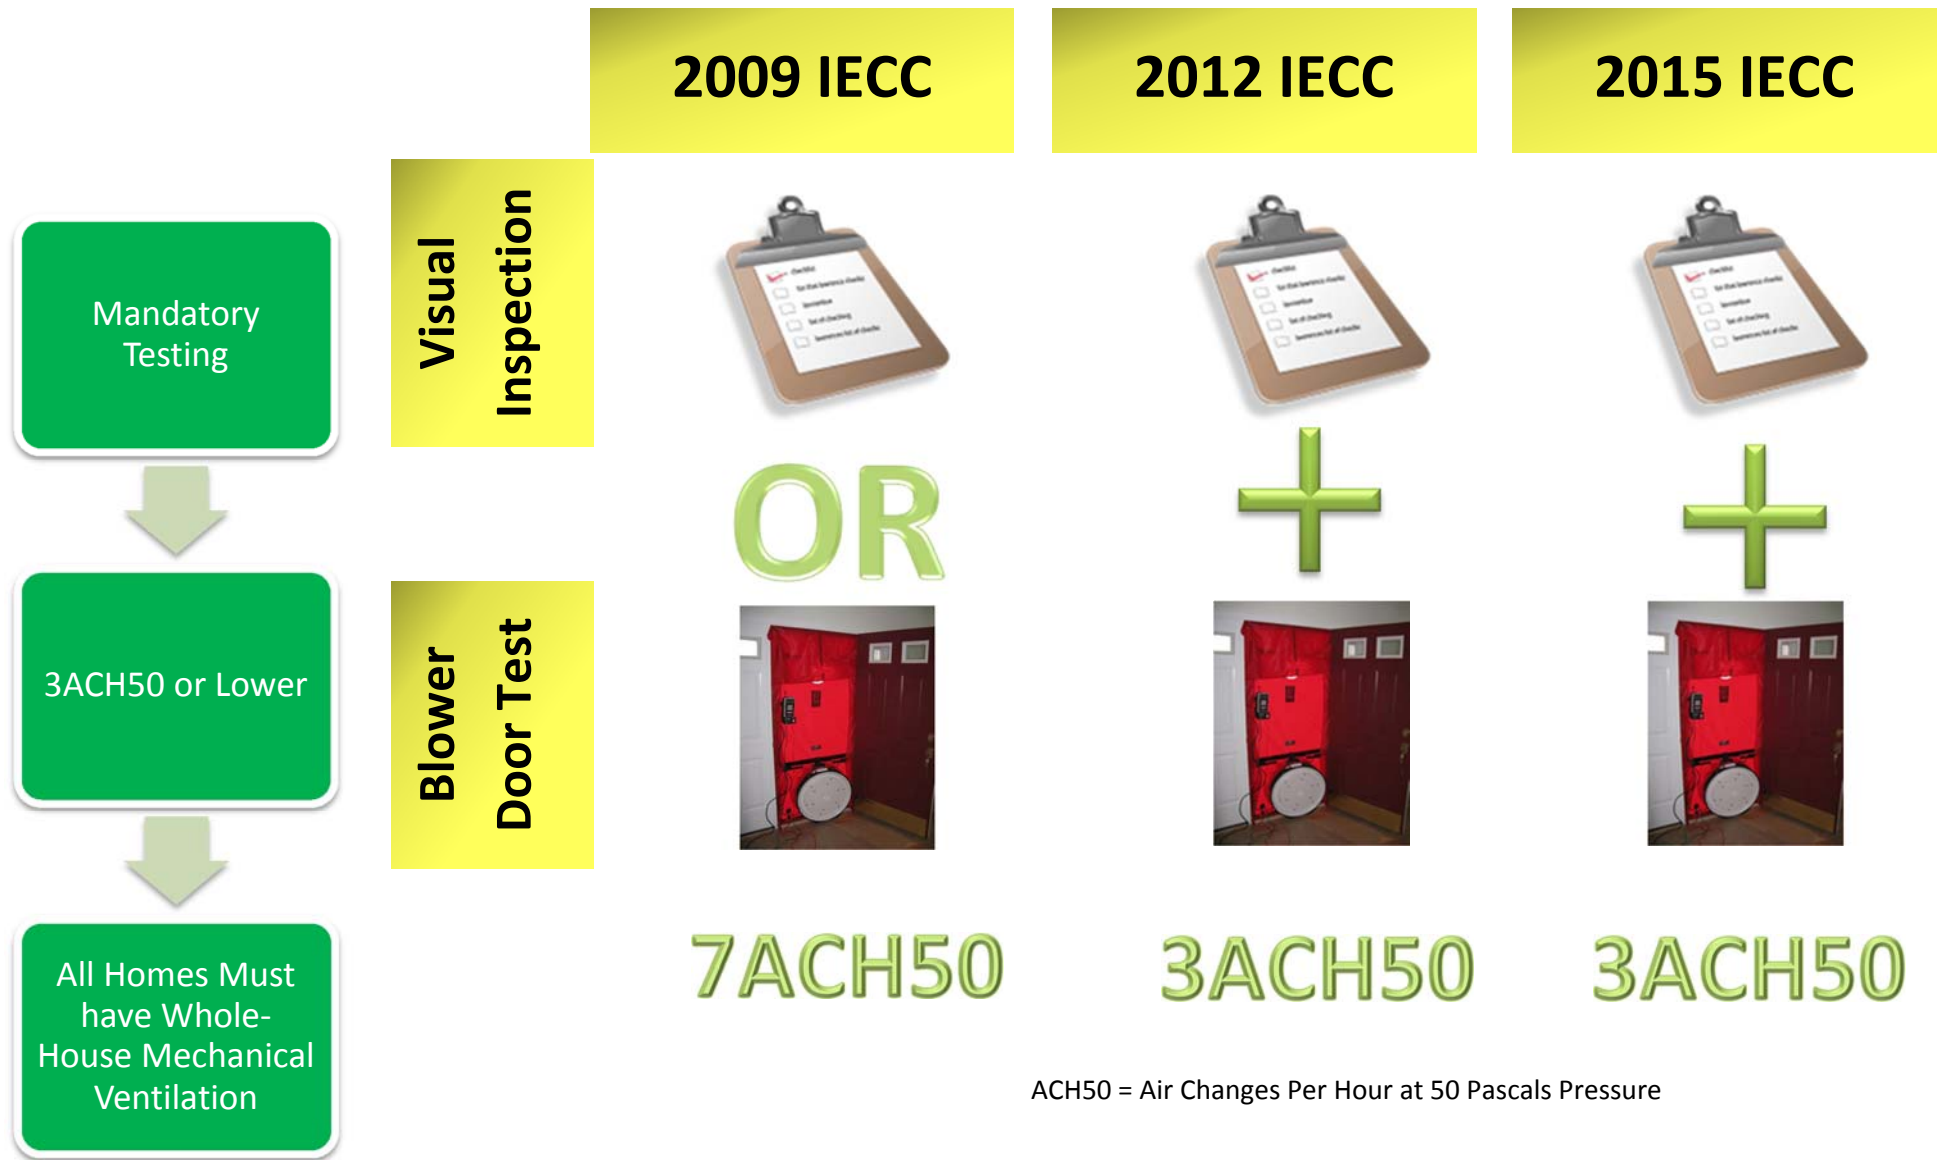

ACH50 = Air Changes Per Hour at 50 Pascals Pressure